


Connection Diagram

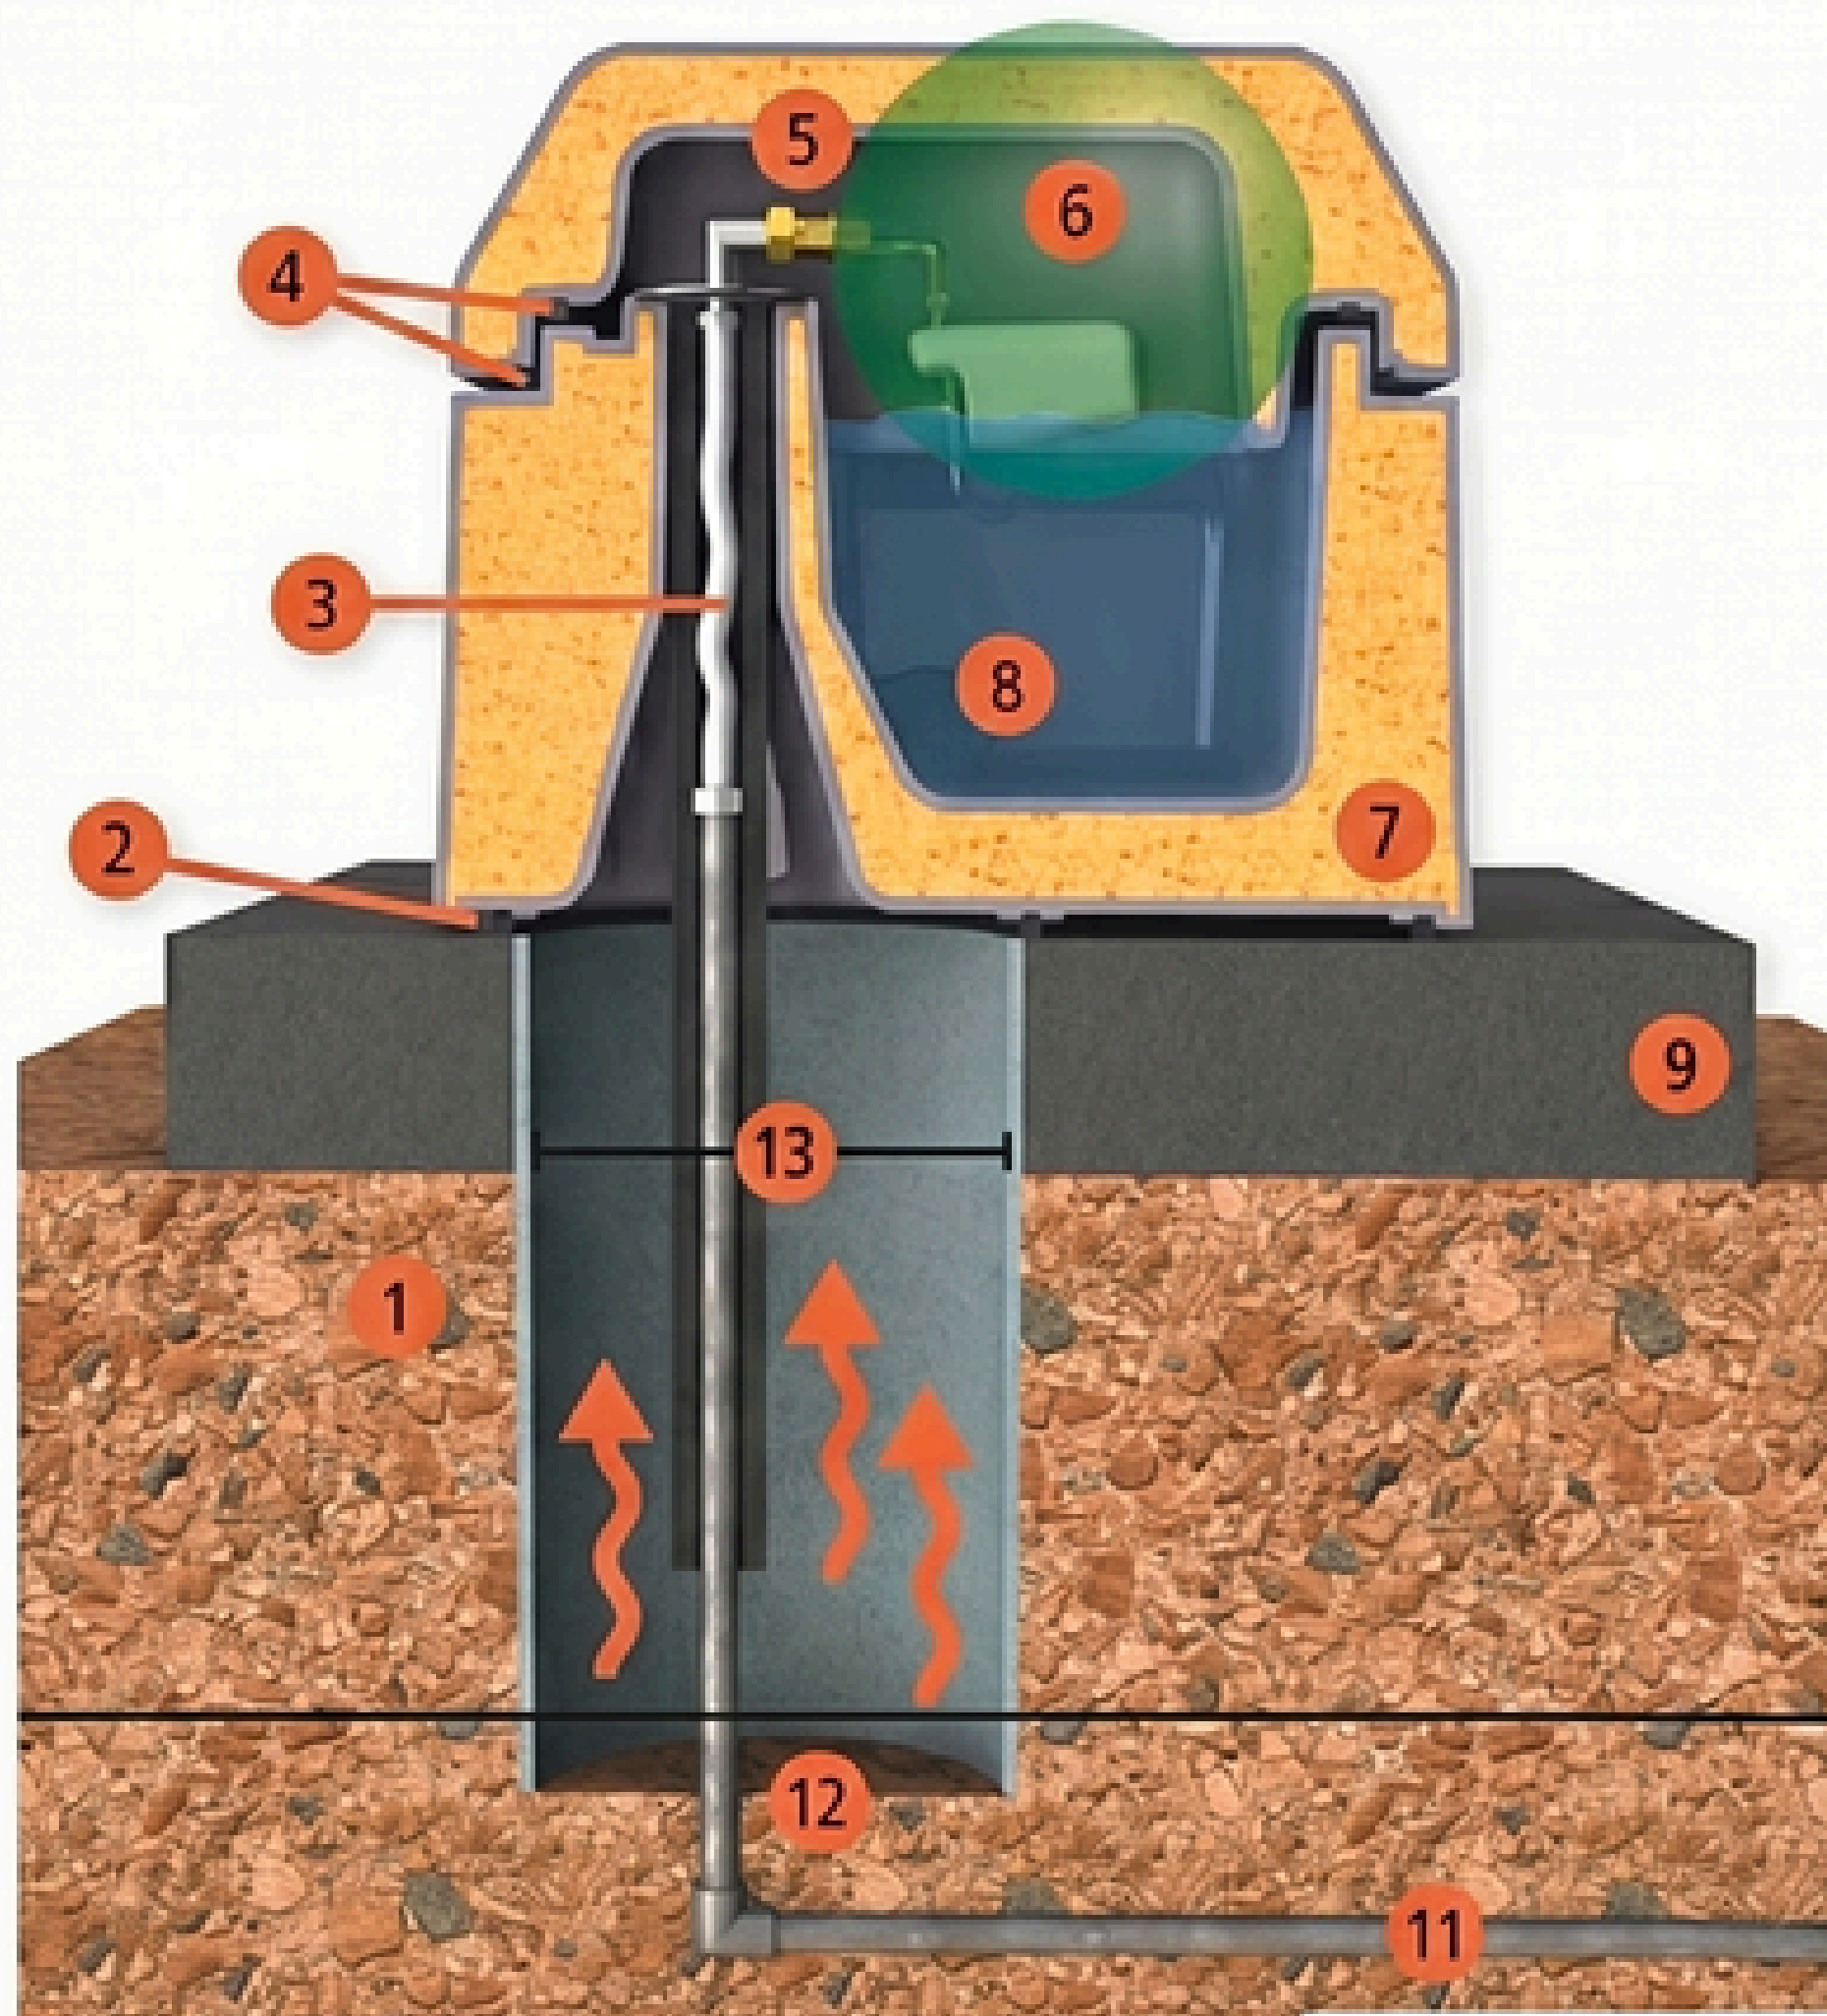

- 1 Pipe Insulation
- 2 Ground Insulation Gasket
- 3 Braided Stainless Steel Hose
- 4 Double Sealing Strips
- 5 Float Valve
- 6 Ball
- 7 PU Rigid Foam Insulation
- 8 Large Quick Drain
- 9 Concrete Mounting Base (min. 15 cm thick)
- 10 Frost-Free Depth (0.8 - 2.0 m - depending on region)
- 11 Water Supply Line 1/2"
- 12 Open Ground to Allow Geothermal Heat to Rise
- 13 Pipe: Minimum Diameter 30 cm